

SKIRTING TO BUILT UP KERB

Remove the existing cover unit or plant item & set aside for re-fixing. (Where an existing item cannot be removed to enable the waterproofing detail to be formed as specified, this may not be covered within the guarantee).

Any exposed openings must be protected against objects/personnel falling through.

Raise the existing built kerb as necessary with timber sections of appropriate dimensions to achieve a minimum 150mm upstand height to the waterproofing detail above the finished roof level.

Apply sufficient coats of the specified BÖRNER PRIME COATING to the detail.

Apply the specified BÖRNER Vapour Control Layer to the primed upstand & dressed to link with the Underlayer by 50mm minimum.

Apply the specified PIR Insulation to the Vapour Control Layer, to be bonded as per BÖRNER Specification Proposal.

Provide 50mm x 50mm specified BÖRNER Angle Fillets to the junction of all horizontal & vertical abutments

Apply the specified waterproofing detailing fully bonded to the vertical and horizontal surfaces of the kerb. Detailing Underlayer and Cap Sheet must be lapped and fully sealed onto the main area as indicated.

Reinstall the plant item or rooflight onto the newly waterproofed kerb.

Allowance should be made for making good any interior decoration, where the unit has been raised to accommodate the waterproofing.

NOTES:


Completed waterproofing upstand details should always be installed so as to achieve a height of 150mm minimum above the finished roof level.

All details to be installed in accordance with BS8217, BS6229, and BÖRNER recommendations.

All waterproofing detailing must be undertaken as two layers and as separate items.

All surfaces must be clean, dry, and suitably prepared to accept the waterproofing system.

During the application of all bitumen membranes a visible bead of bitumen must be exuded from all side and end laps.

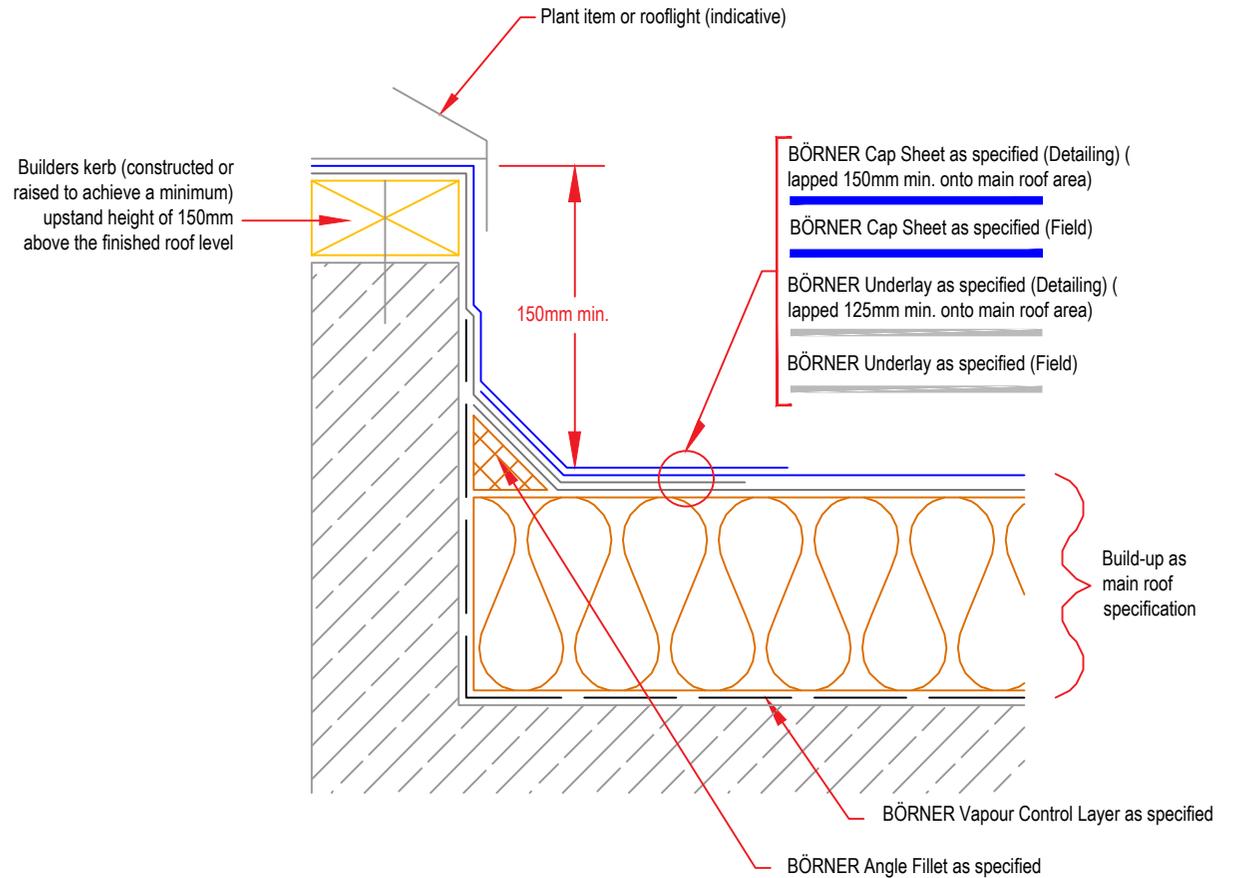

Copyright Reserved - Please note that this drawing & the copyright therein is the property of BÖRNER & is issued on the understanding that the drawing or any detail thereof will not be divulged to a third party unless written permission is first obtained from BÖRNER technical services department. The drawing is valid only when approved by the Architect / Contractor concerned.

This detail is representative of a typical situation and provided for illustration purposes. Insulation thickness shown may differ in accordance with specifiers U value requirement.

Standard Detail

Drawing Title:

Skirting to Built Up Kerb

Date:
2018

Notes / Revisions:

Scale:
NTS

Drawing No.

B16

Drawn By:
BÖRNER



BÖRNER. Systematically sealed.

Email: info@borner.ie